


FACILITY CHILLED WATER
 <25°C NON-CONDENSING
 QUALITY SUPPLY.
 2 bar DIFF. PRESSURE

REACTOR
 CABINET ROOF
 1/2" SWAGELOK

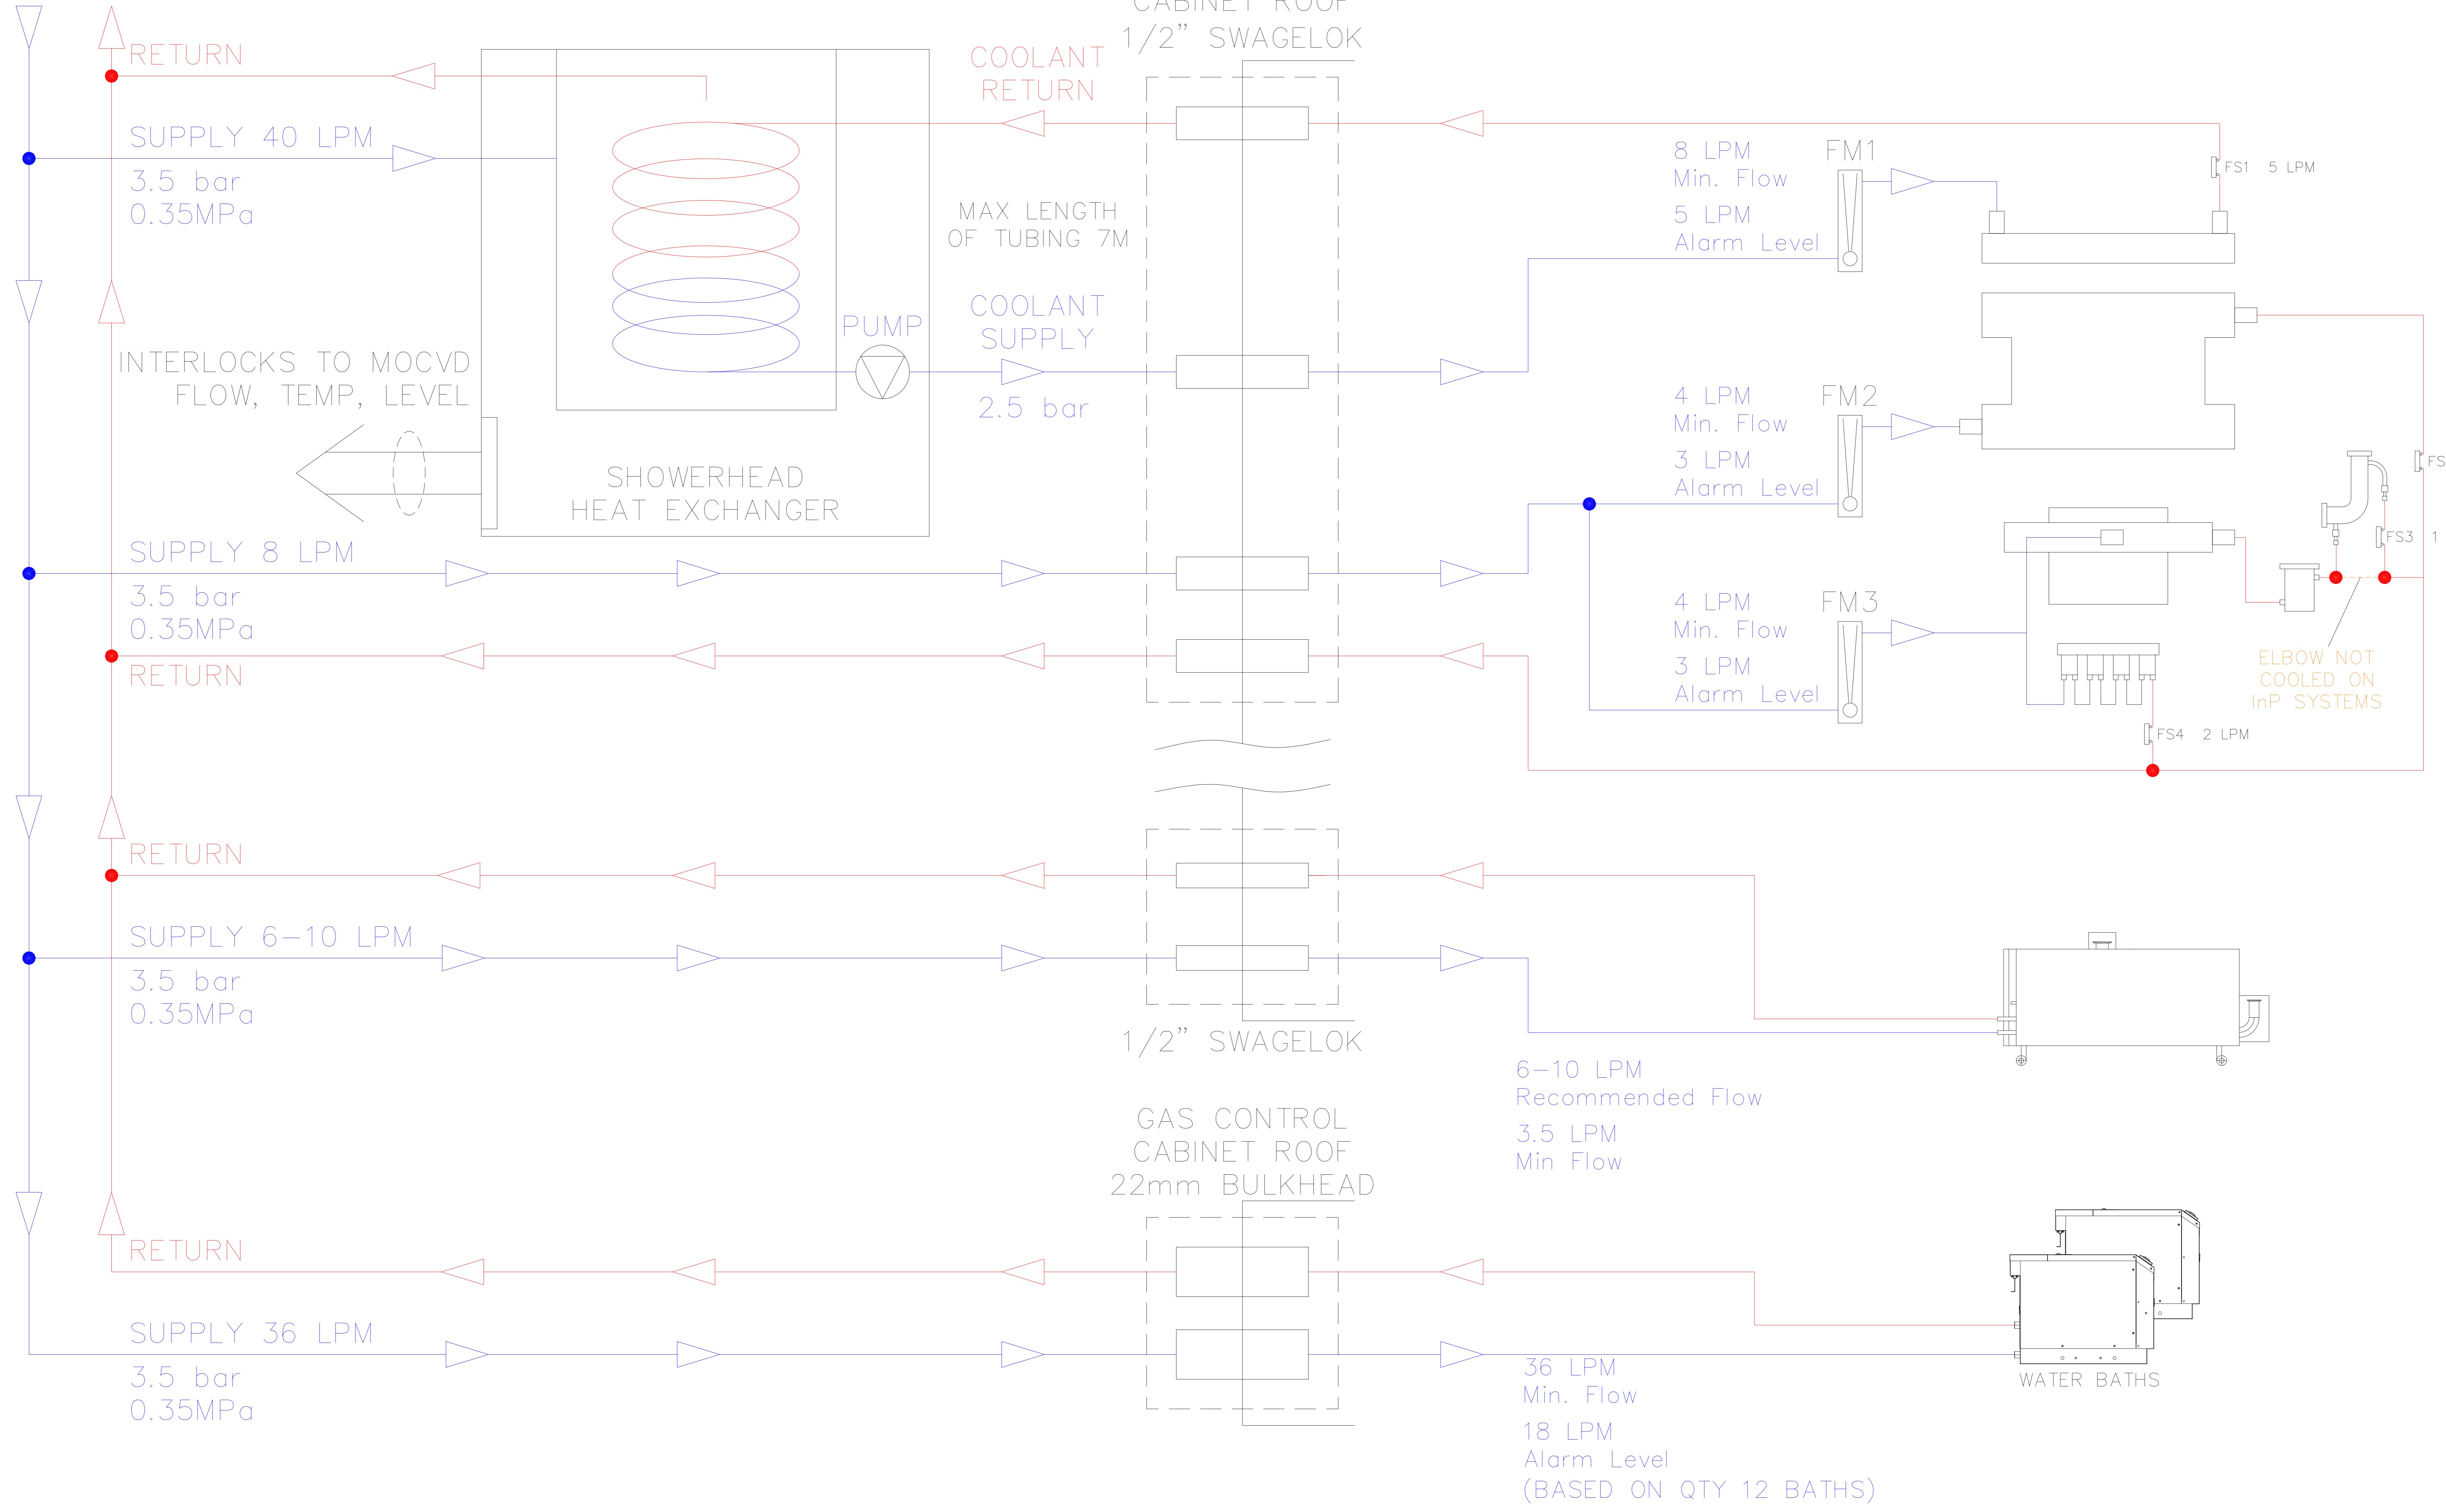

- CIRCUITS:
1. SHOWERHEAD
 2. CHAMBER
 3. BUSBARS, FERRO, FILTER & EXHAUST ELBOW
 4. EBARA DRY VACUUM PUMP
 5. WATER COOLED BATHS

HEATLOAD PER CIRCUIT (kW)		
SHOWERHEAD	CHAMBER	BUSBARS, FILTER & EXHAUST ELBOW
9	7	4

Created by JED	Third angle projection ISO 128	Material —	General tolerances according to ISO 2768 - f H
Approved by PS	All dimensions are in mm (unless otherwise stated)	Finish —	General surface texture: ISO 1302 (unless otherwise stated) √Ra 3.2
Date 08-11-21	Scale 1:1	Size A1	Material No. 100272080
Title EXTERNAL WATER CIRCUIT 3x2", 1400			Document Status/Sheet RELEASED 1/1
			Document No. A1-65413C